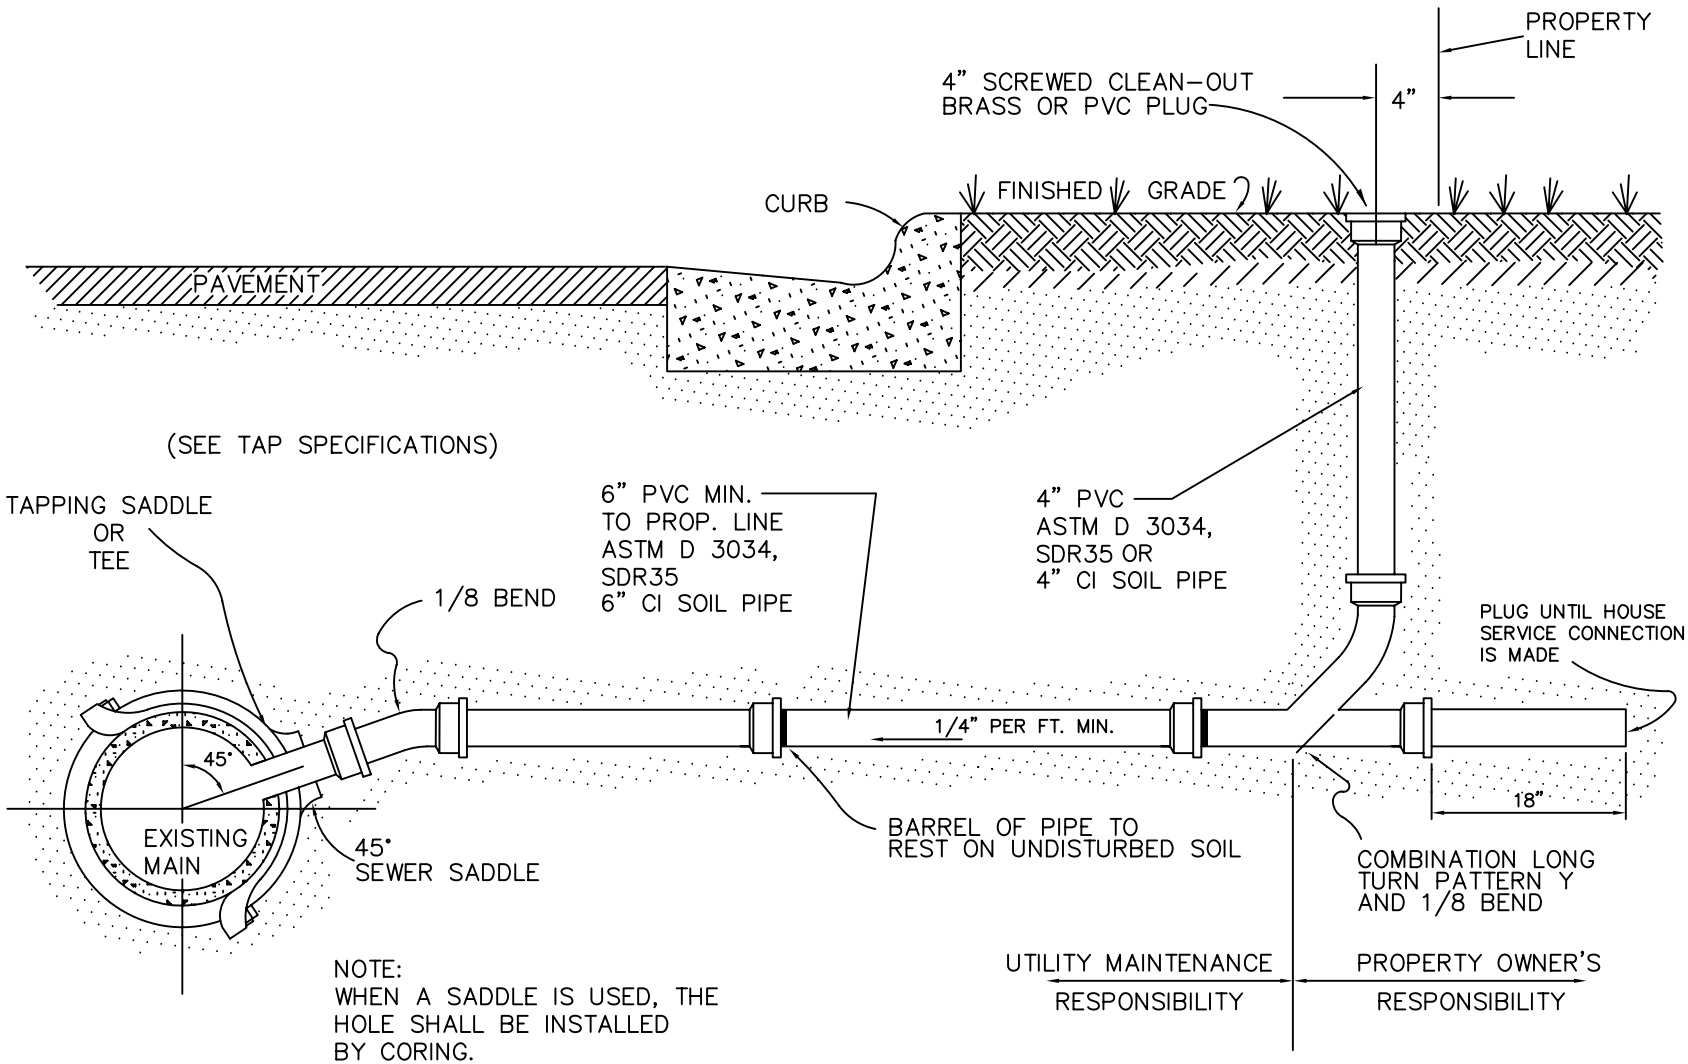

NOTE:
WHEN A SADDLE IS USED, THE HOLE SHALL BE INSTALLED BY CORING.

NOTE:
THE FULL LENGTH OF THE SERVICE DITCH SHALL BE COMPACTED IN 6" LAYERS WITH MECHANICAL TAMP. GUARD STAKE REQUIRED AT CLEANOUT LOCATION UNTIL LANDSCAPING IS COMPLETED

DATE: 7/1/93	REVISIONS	STANDARD DETAIL	LEXINGTON COUNTY JOINT MUNICIPAL WATER AND SEWER COMMISSION
SCALE: NTS		SANITARY SEWER LATERAL CONNECTION	FILE NO. 71B-7