


CONTROL PANEL TO BE MOUNTED ON A 2 1/2" DIA. GALVANIZED PIPE SET IN CONCRETE. AUDIBLE AND VISUAL HIGH WATER ALARM TO BE MOUNTED ON TOP OF THE CONTROL PANEL.

MINIMUM 6" #57 STONE WITHIN FENCE AREA

25'x25'x6' CHAIN LINK FENCE

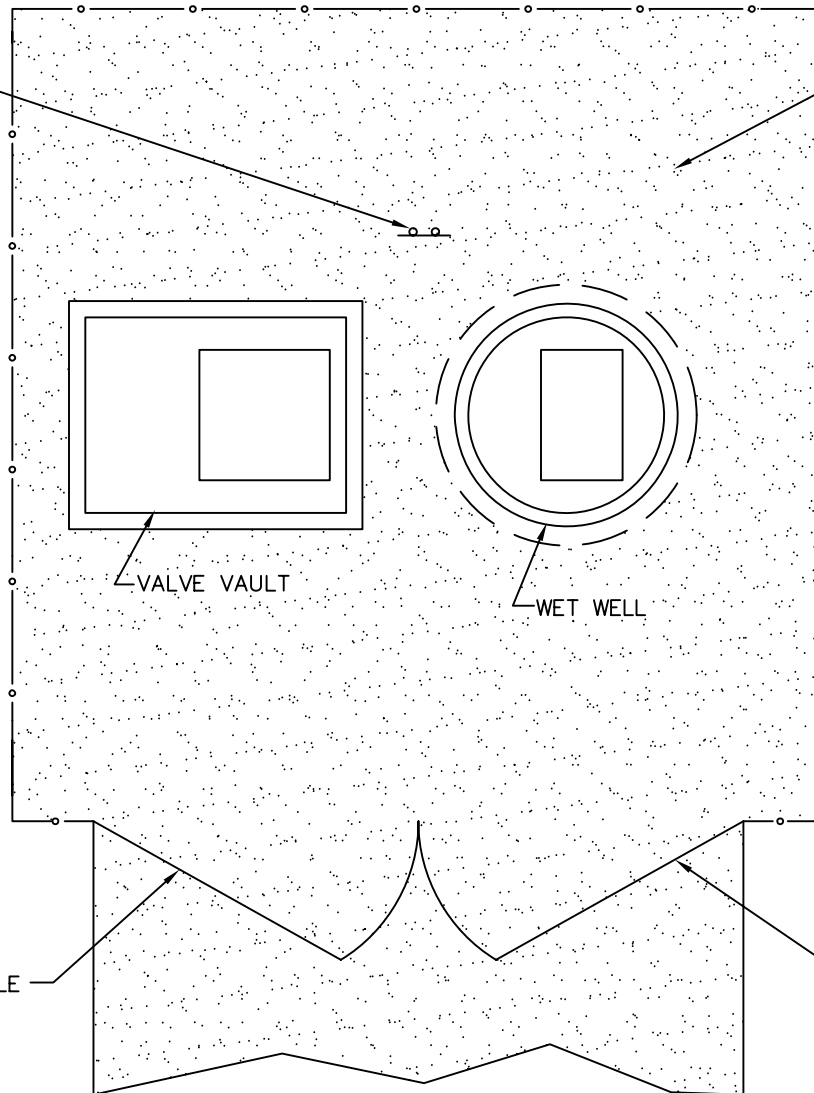

VALVE VAULT

WET WELL

20' WIDE DOUBLE SWING GATE

A SIGN STATING "IN CASE OF EMERGENCY CALL 359-8373 SHALL BE FURNISHED AND ATTACHED TO THE FENCING. SIGN TO BE 12" WIDE BY 24" HIGH, WITH 2 1/2" LETTERS.

DATE:
12/07/2004

REVISIONS

STANDARD DETAIL

LEXINGTON COUNTY
JOINT MUNICIPAL
WATER AND SEWER
COMMISSION

SCALE:
NTS

TYPICAL LIFT STATION SITE PLAN

FILE NO. SP006N