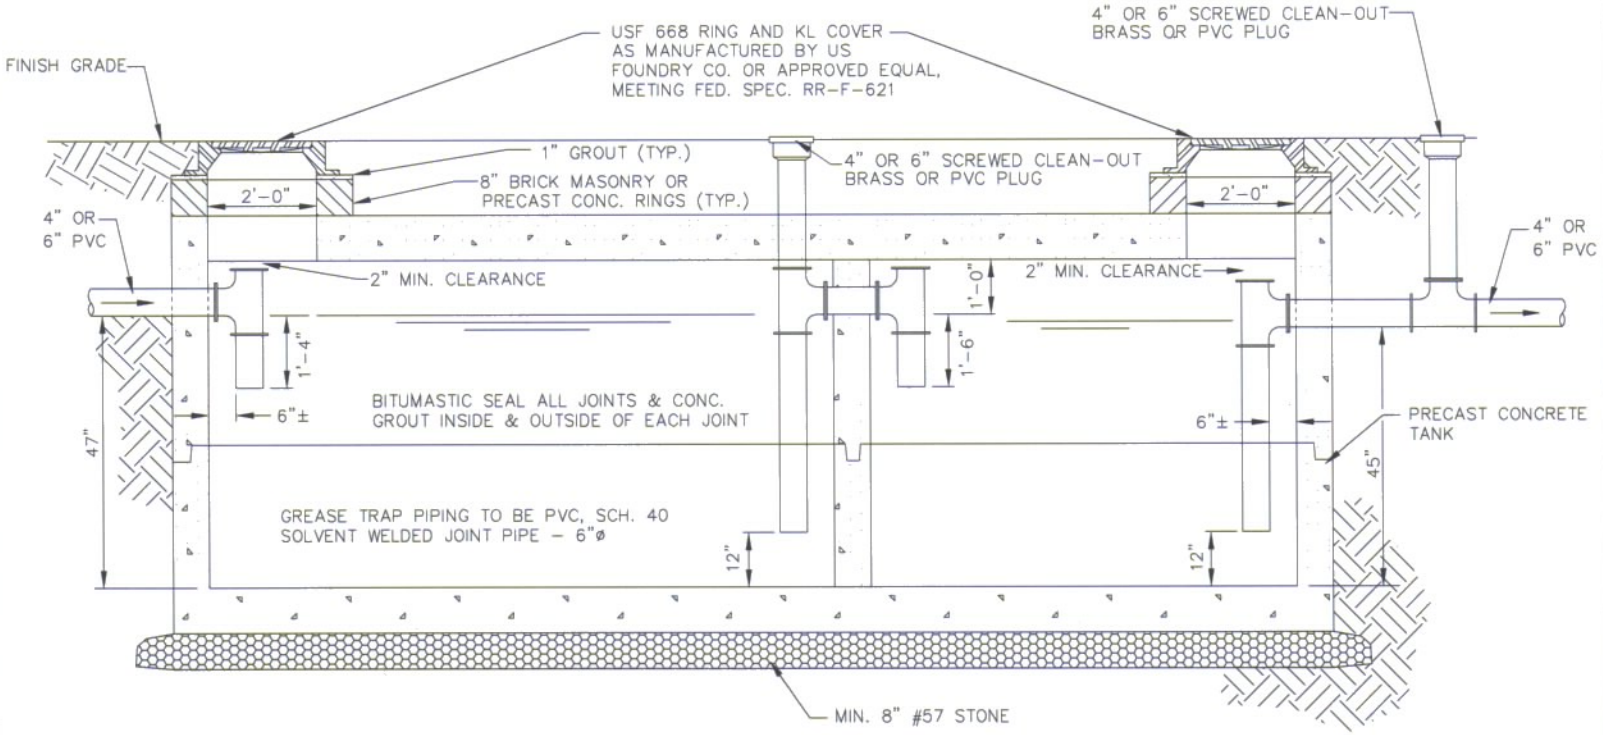

NOTE: 1. THE CONTRACTOR SHALL SUBMIT SHOP DRAWINGS TO DESIGN ENGINEER FOR APPROVAL.
2. THE DESIGN ENGINEER SHALL SIZE THE GREASE TRAP FOR THE PROPOSED APPLICATION.
3. THE INVERT OF THE INLET PIPE SHALL NOT BE LESS THAN 2" ABOVE THE INVERT OF THE OUTLET PIPE.
4. THE BAFFLE WALL SHALL BE LOCATED 2/3 DISTANCE FROM THE INLET SIDE, FOR GREASE ACCUMULATION, AND 1/3 DISTANCE FROM OUTLET SIDE.

DATE: JULY, 2010	REVISIONS		STANDARD DETAIL	JOINT MUNICIPAL WATER AND SEWER COMMISSION
	11/10	GENERAL		
SCALE: NTS			PRECAST CONCRETE GREASE TRAP	FILE NO. 71B-9